




RAMP CONFIGURATION A

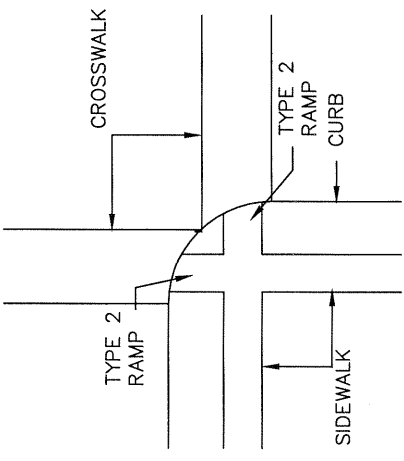


RAMP CONFIGURATION B

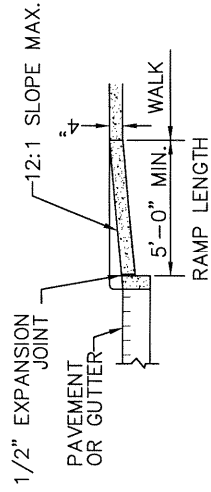


SECTION A-A

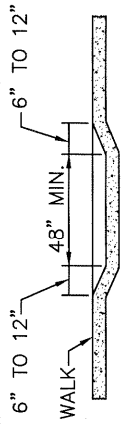

SECTION D-D




SECTION C-C

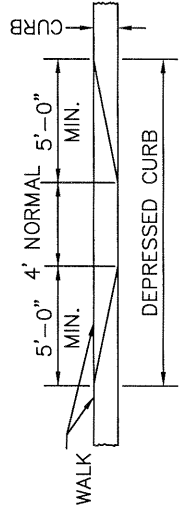


VIEW B-B

CURB RAMPS NOTES

- A. VILLAGE TO SPECIFY TYPE 1 OR TYPE 2 CURB RAMP.
- B. ANY COMBINATION OF SIDE SLOPES ON OPPOSITE SIDES OF A RAMP MAY BE USED TO BEST FIT THE SITE CONDITIONS.
- C. THE MINIMUM RAMP LENGTH IS 5' FROM BACK OF A 6" CURB AND MAY BE INCREASED WHERE FEASIBLE TO OBTAIN A FLATTER RAMP SLOPE OR TO BETTER BLEND WITH THE WALK CONFIGURATION.
- D. WALK THICKNESS IN THE RAMP SLOPES SHALL BE 4" MINIMUM OR THICKER AS NECESSARY TO MATCH ADJACENT WALK THICKNESS.
- E. CURB RAMPS SHALL MEET AND BE FINISHED TO A.D.A. STANDARDS.
- F. CURB RAMPS SHALL MEET THE REQUIREMENTS OF ODOT ITEM 608 UNLESS OTHERWISE SPECIFIED WITHIN.
- G. CONCRETE SHALL BE ODOT CLASS C (4000 PSI, 600 LB/CY CEMENT). PROPORTIONING OPTIONS 1 AND 2 NOT ALLOWED.
- H. CONCRETE SHALL CONTAIN 6% ± 1% OF TOTAL AIR.
- I. 4" OF COMPACTED ODOT ITEM 304 OR ITEM 411 AGGREGATE BASE SHALL BE PLACED ON COMPACTED SUBGRADE UNDER ALL SIDEWALK AND CURB RAMPS.

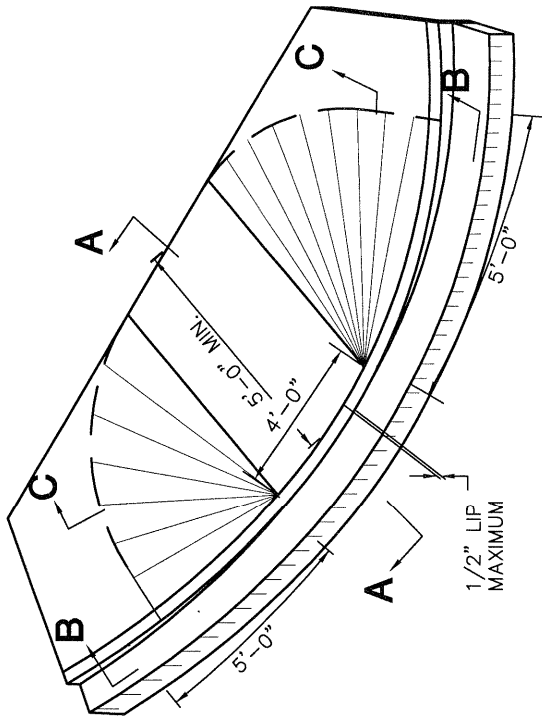

TYPE 1 RAMP DETAIL

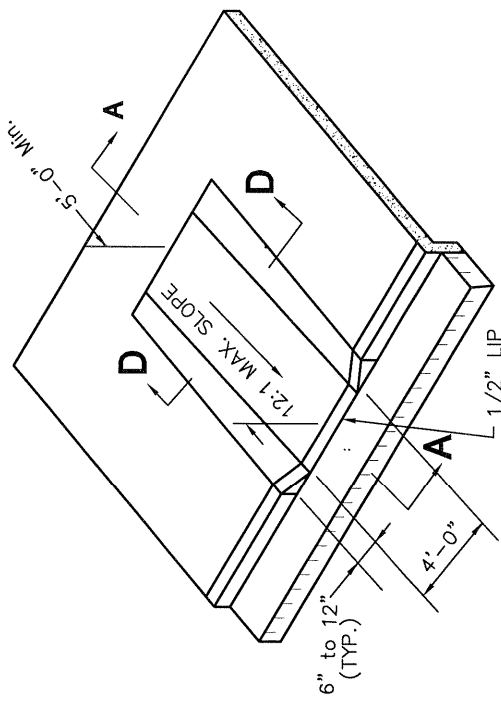

TYPE 2 RAMP DETAIL

CURB RAMPS