


NOTES

- A.** FOR 4" AND GREATER SERVICES
- B.** PIPING SHALL BE D.I.P., CLASS 53 TO RIGID FLANGE, FROM RIGID FLANGE THROUGH METER VALVES AND BYPASS TO BE DUCTILE, COPPER OR BRASS.
- C.** FOR 1 1/2" AND 2" SERVICES: WATER DEPARTMENT RECOMMENDS THE USE OF COPPER PIPING
- D.** FULL PORT BALL VALVES MUST BE INSTALLED FOR 1 1/2" AND 2" METERS AND MUST BE LOCKABLE.
- E.** BYPASS MANDATORY FOR ALL METERS. BYPASS VALVE TO BE LOCKABLE.
- F.** DUAL INSTALLATION FOR BACKFLOW PREVENTION DEVICES IS OPTIONAL FOR 1 1/2" - 2" METERS.
- G.** ALTERNATE DESIGNS MAY BE SUBMITTED TO WATER ENGINEERING FOR APPROVAL.
- H.** PROVIDE SPREADER DEVICE FOR PROPER ALIGNMENT ON INSTALLATION OF METER SPREAD.
- I.** NO FLANGE ADAPTERS BEFORE INITIAL SHUT-OFF VALVE(S)
- J.** BFP TO BE WATTS 909, AS DETERMINED BY THE VILLAGE.

RETAINER GLAND
 AGAINST FOUNDATION
 WALL OR AN APPROVED
 ANCHORING WALL SLEEVE
 (IF D.I.P.)

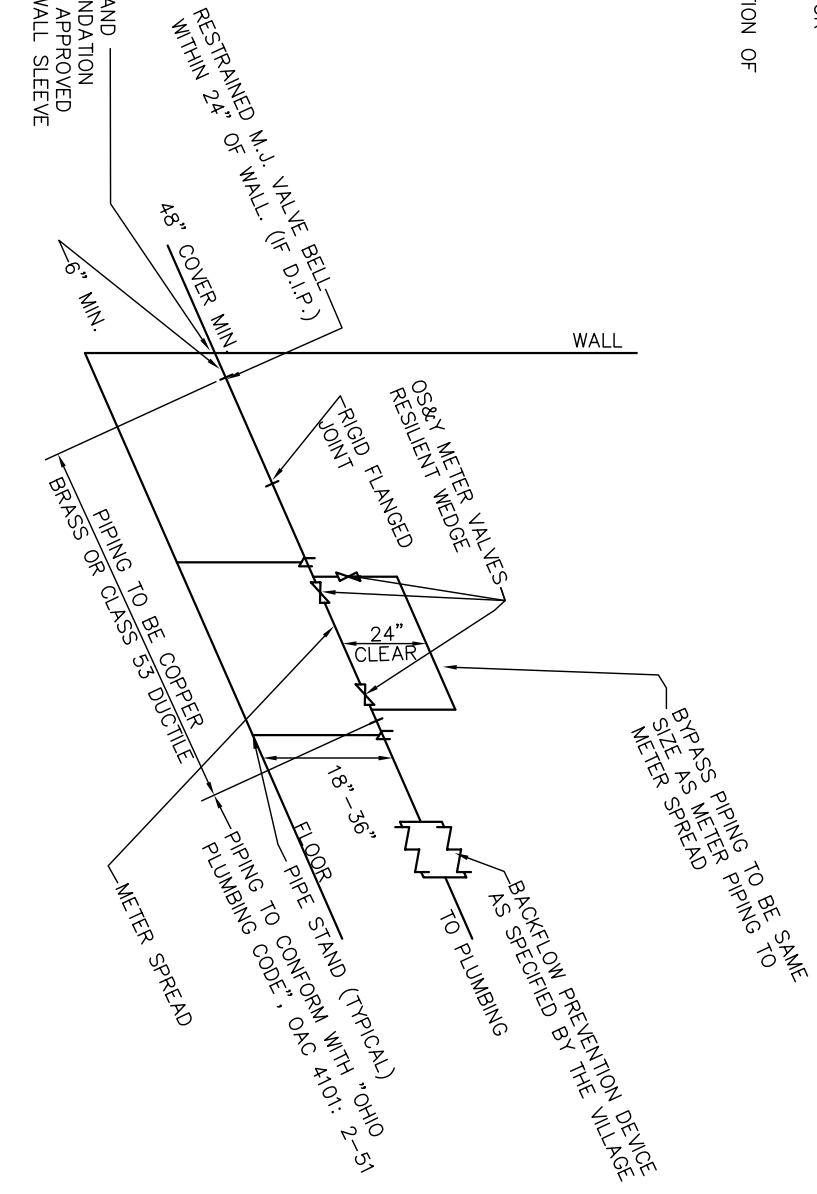

**TYPICAL LARGER METER LAYOUT
 IN BUILDING**