


LIMITED AREA SPRINKLER SYSTEM DETAIL

REVISIONS:
FEB. 2001

DATE APPROVED:
AUG. 1999
PAGE No.
800-17

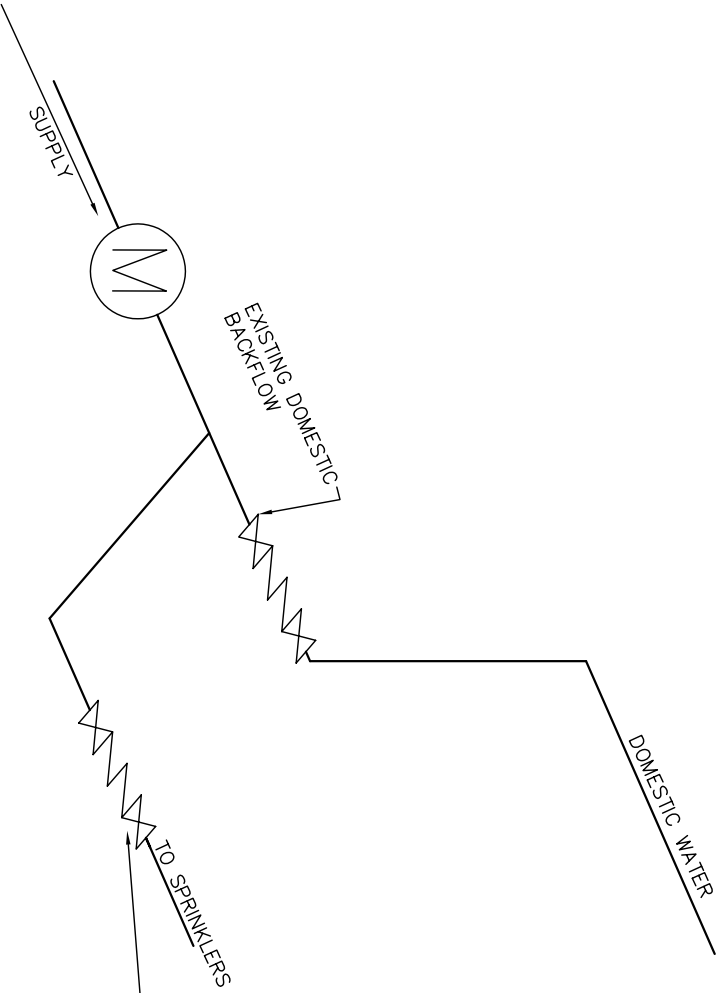

- 1. TESTABLE DOUBLE CHECK VALVE (ASSE 1015) AT POINT OF CONNECTION TO DOMESTIC PIPING
- 2. LOCKABLE VALVES "SUPERVISED" PER OHIO BASIC BUILDING CODE 10:20

NOTE:
A. ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEM WILL AFFECT ORIGINAL FLOW CALCULATION

