


2" FIRE LINE SERVICE
(METER REQUIRED)

- SERVICE TEES ARE PERMITTED IF .**
1. SHOWN ON AN APPROVED SET OF CONSTRUCTION DRAWINGS.
 2. 4" MINIMUM BRANCH AND SERVICE LINE WITH GATE VALVE WITHIN 3' OF MAIN.

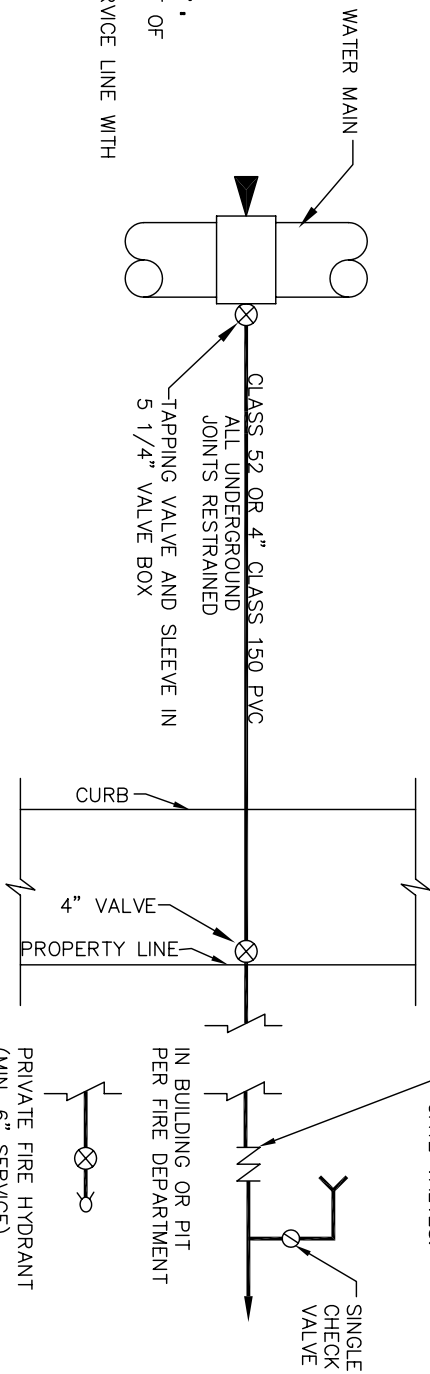

4" AND LARGER FIRE LINE SERVICE

WALL/POST INDICATOR
VALVES SHALL BE ADDED
ON PREMISES AT FIRE
DEPARTMENT REQUEST

VILLAGE OF
ADA



**2" FIRE LINE AND
4" AND LARGER FIRE LINE**

REVISIONS:
FEB. 2001

DATE
APPROVED:
AUG. 1999

PAGE No.

800-18