


# COMBINATION FIRE AND DOMESTIC IN BUILDING

- NOTES**
- A. ALL UNDERGROUND JOINTS MUST BE RESTRAINED.
  - B. INSIDE PIPING SHALL BE D.I.P. CLASS 52 TO RIGID FLANGE, FROM RIGID FLANGE THROUGH METER VALVES AND BYPASS, TO BE D.I.P., K-COPPER OR BRASS.
  - C. MINIMUM 1 1/2" WATER METER.
  - D. ALTERNATE DESIGN MAY BE SUBMITTED TO VILLAGE FOR APPROVAL.
  - E. COMBINATION SERVICE NOT PERMITTED INSIDE BUILDING IF THE DOMESTIC METER IS MORE THAN 75 FEET FROM THE PROPERTY/EASEMENT LINE.



VILLAGE OF  
ADA

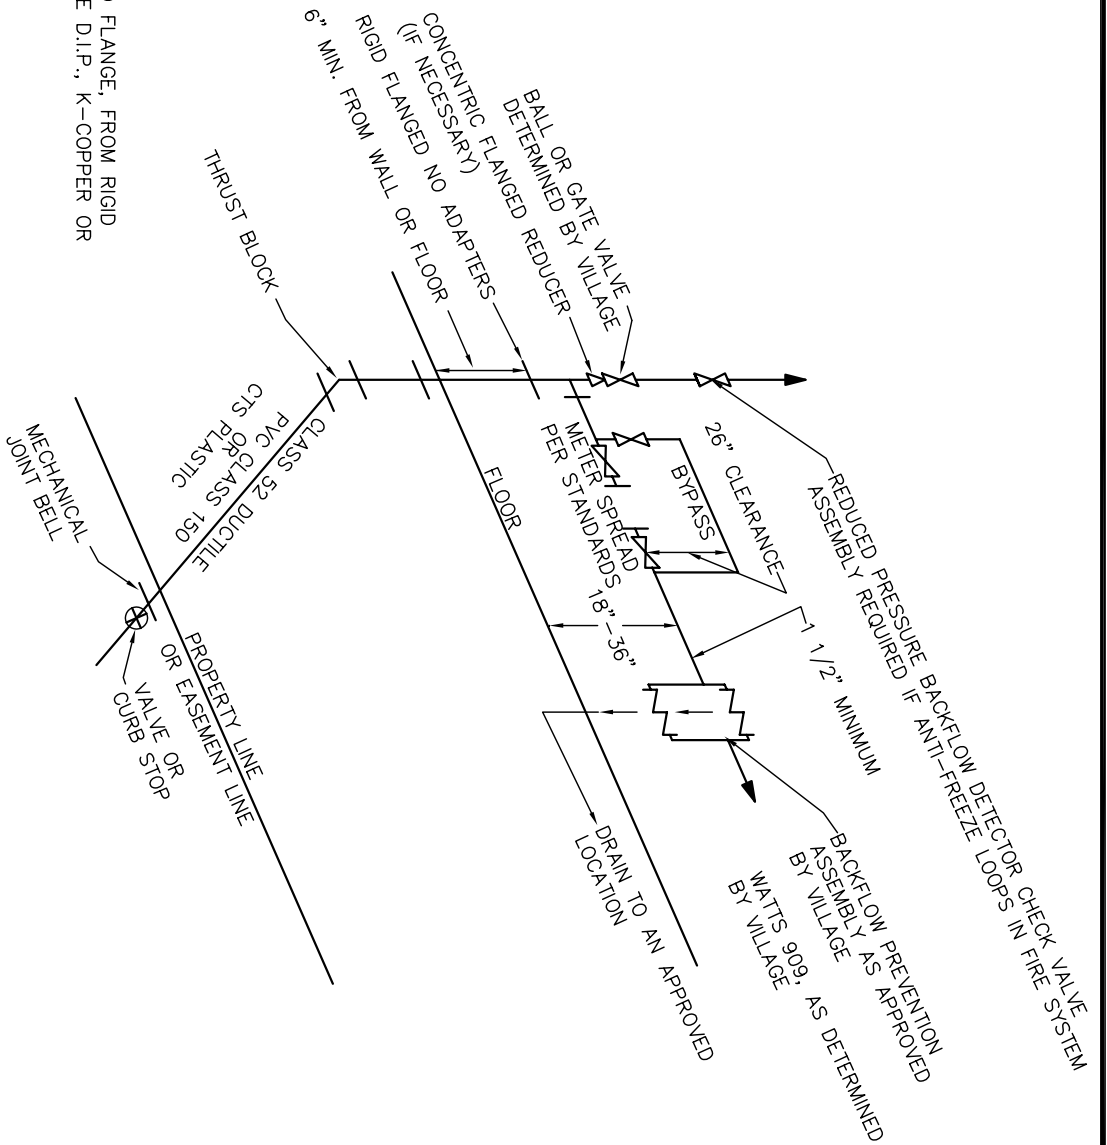

REVISIONS:  
FEB. 2001  
MAR. 2003

DATE APPROVED:  
AUG. 1999  
PAGE No.  
800-19