


NOTES


- A. 18" I.D. TILE FOR FORD NO. X-32 LID OR EQUIVALENT (5/8" METERS).
- B. 20" I.D. TILE FOR FORD NO. X-3 LID OR EQUIVALENT (1" METER OR DOUBLE 5/8" METER).
- C. PLASTIC METER TILE, OTHERS MUST BE APPROVED PRIOR TO INSTALLATION.
- D. METER PIT AND CURB STOP TO BE LOCATED AS DIRECTED BY THE VILLAGE.
- E. METER PIT PROVIDED BY VILLAGE AND PAID FOR THROUGH TAPPING FEE.
- F. VILLAGE WILL DETERMINE LOCATION OF METER PIT AND WHETHER A FROST-PROOF OR STANDARD LID WILL BE SET.
- G. UNSATISFACTORY INSTALLATION WILL RESULT IN WATER NOT BEING TURNED ON.
- H. METER PIT LID MUST BE FLUSH OR 1" BELOW FINISHED GRADE. IF FRAME OF METER LID IS SHOWING, POSSIBILITY OF FREEZING OF METERS AND SERVICE LINES IS INCREASED AND VILLAGE POLICY IS THE VILLAGE'S RESPONSIBILITY STOPS AT THE FIRST SHUT-OFF VALVE.
- I. SERVICE LINE IS TO BE BEDDED IN 4" AND COVERED WITH 12" OF 703.05 NATURAL OR MANUFACTURED SAND FROM WATER MAIN TO CURB STOP OR METER PIT.
- J. 4'-0" MINIMUM BACKFILL COVER OVER SERVICE LINE.

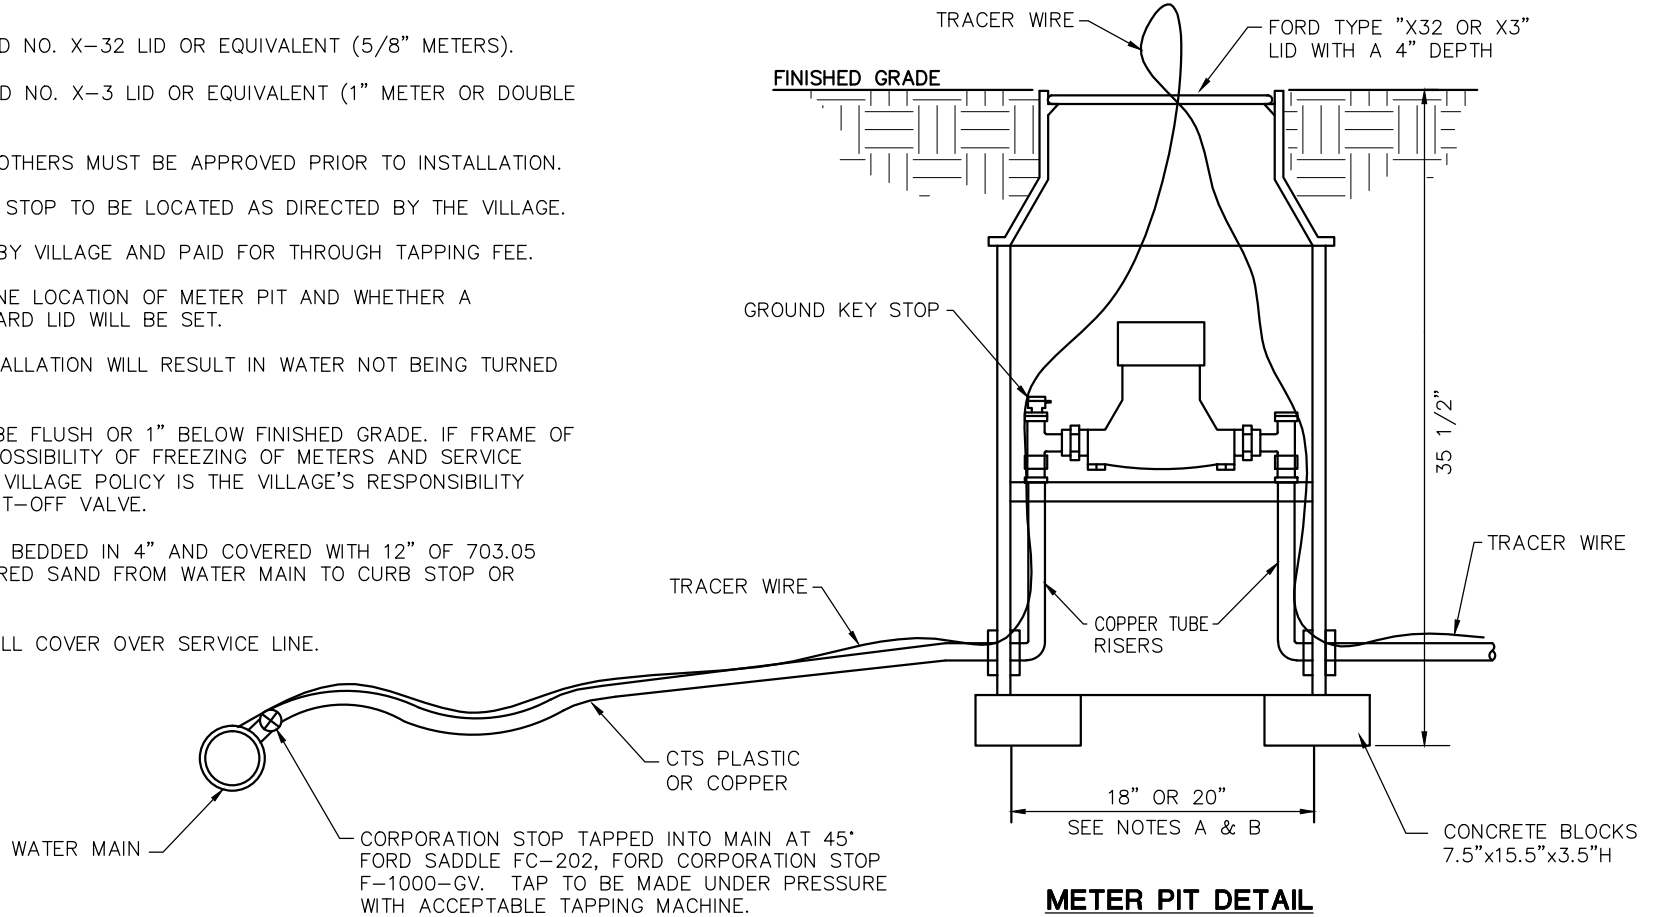

METER PIT DETAIL

- PDB-188-18-36
SINGLE 5/8" METER - X32 LID
- PDDB-188-20-36
DOUBLE 5/8" OR 1" METER - X3 LID

VILLAGE OF
ADA



**METER PIT INSTALLATION
STANDARD LID**

REVISIONS:
JULY 2008
AUG 2012
JULY 2014

DATE
APPROVED:
MAY 1997
PAGE No.
800-8